
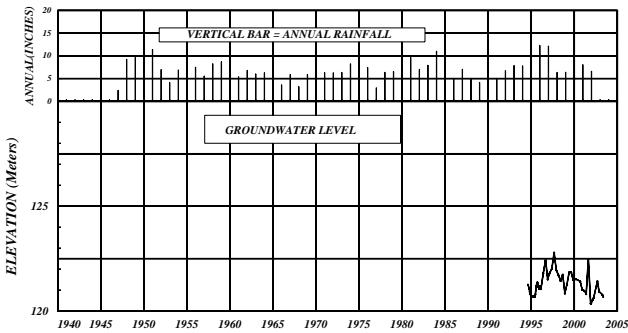
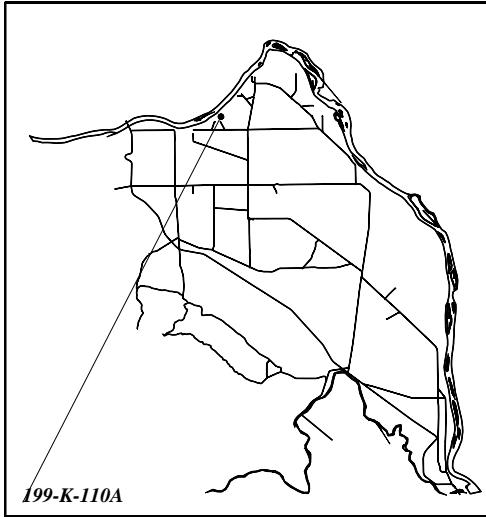


DOE HANFORD SITE - GROUNDWATER QUALITY DATA PLOTS



wellseries-100-199 WELL#=199-K-110A

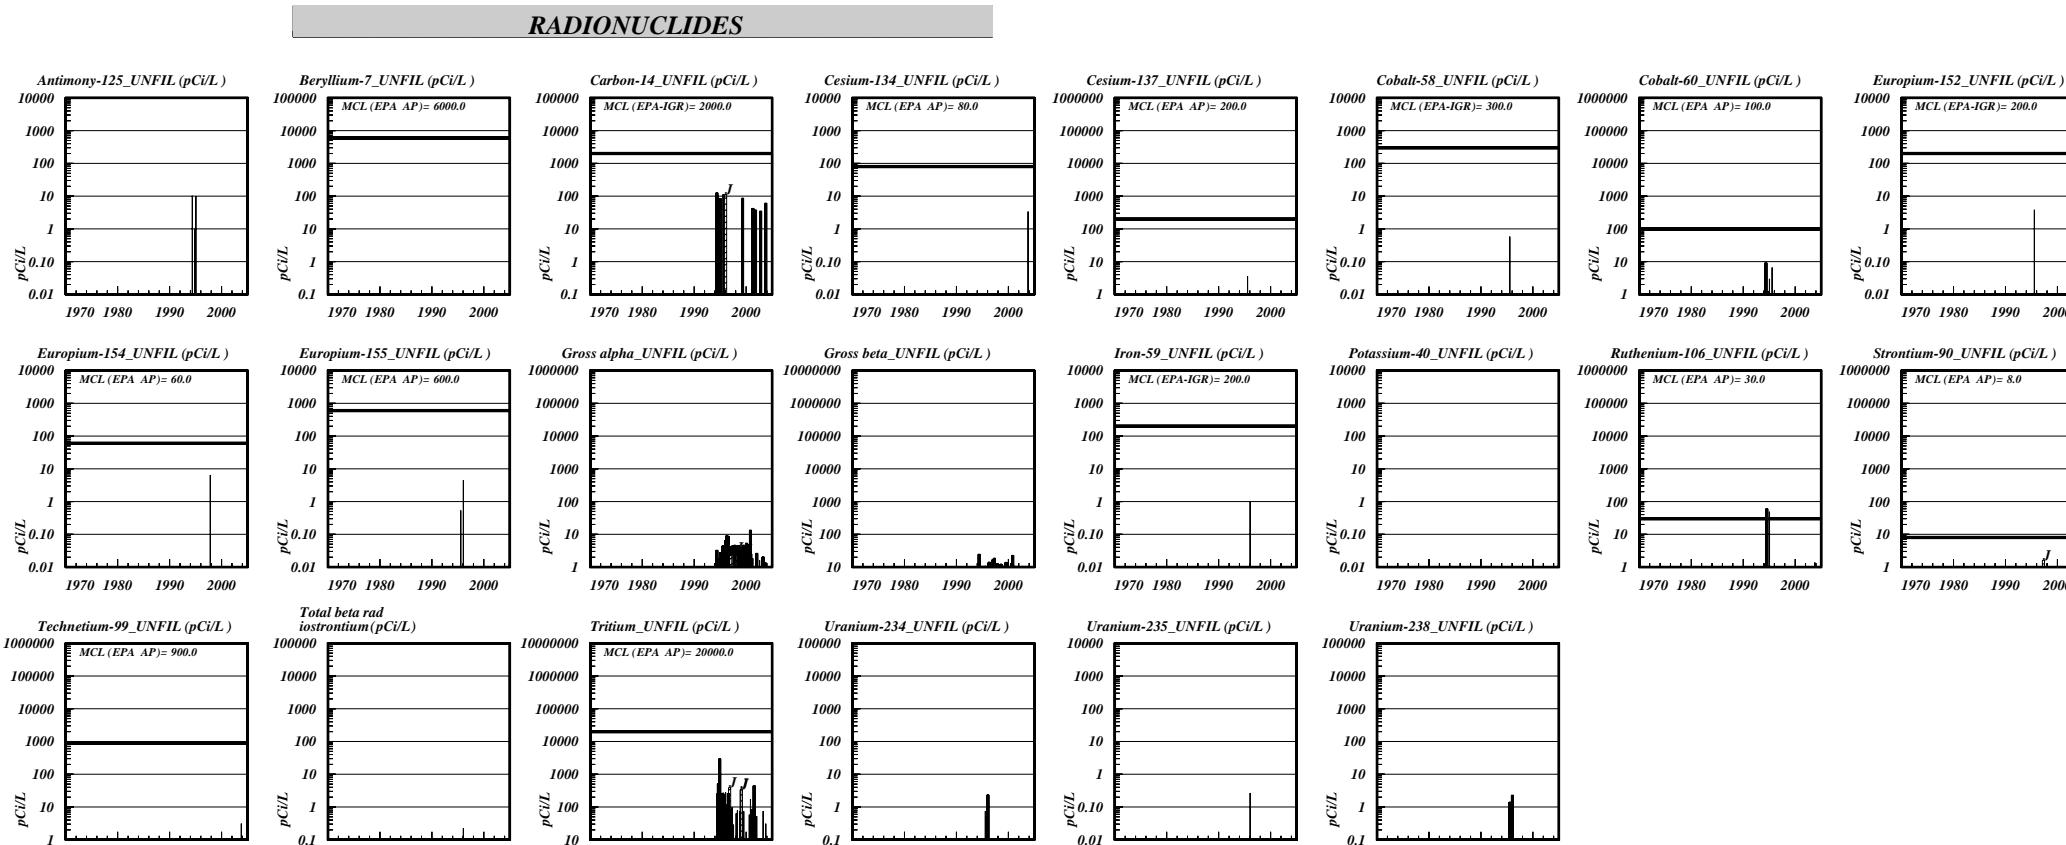

VOLATILE ORGANIC COMPOUNDS NO DATA AVAILABLE

SEMI-VOLATILE ORGANIC COMPOUNDS NO DATA AVAILABLE

METALS & PHYSICAL PARAMETERS

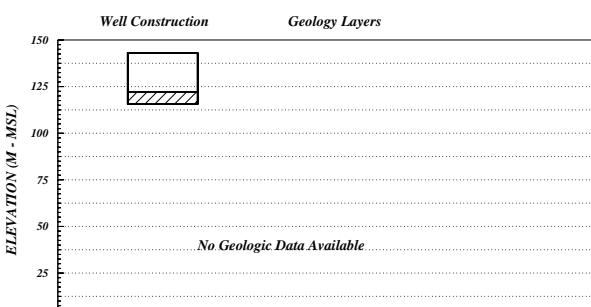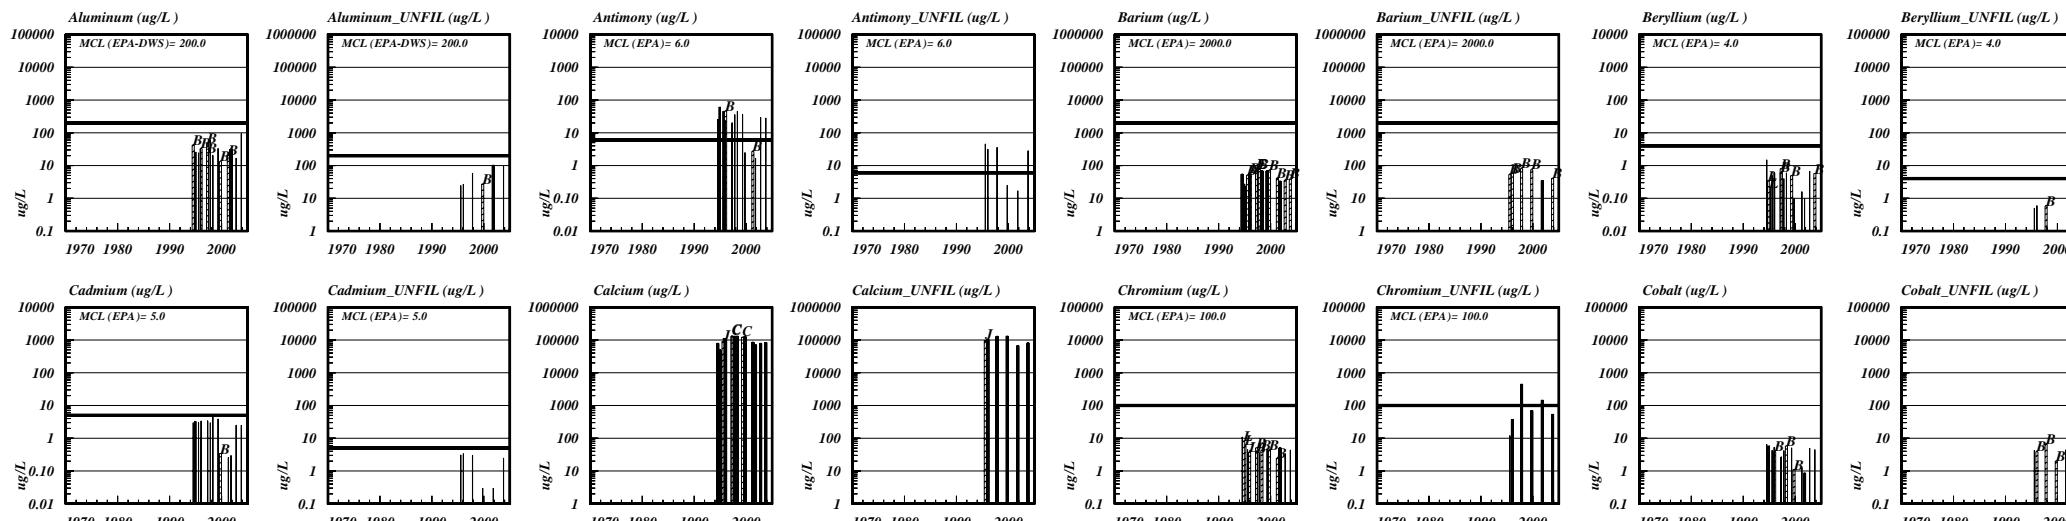

WELLNAME=199-K-110A WELLID=A9829

Well Type=STANDARD Well purpose=GROUNDWATER
 Owner=DOE Contact=BHI Well Adm=Compliance=COMPLIANT
 Well Construction Date= 5/20/1994
 X_coor= 569230.00 Y_coor= 146677.90 Datum=NAD83(91) Date Survey=10/20/1994
 Elevation= 143.009 Datum=NAVD88 Date Survey=10/20/94
 Ref Point Desc=TOP OF CASING Ref Point side=NONE Contractor=KEH
 Total Number of Screen Intervals=1
 Screen#=1 Screen_diam= 4.00 in Top= 20.92 Bottom= 27.34 m Slot_size= 0.04 in
 Screen_material=Stainless Steel


LABORATORY QUALIFIER FLAGS in HEIS are *, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value; L=Value between IDL and CRQL (estimated); T=Tentatively identified compound:
 EPA-IGR=EPA-Implementation Guidance for Radionuclides: WAC=Washington Administrative Code:

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit; THIN BARS=Value Below Detection Limit; HATCHED BARS=Value With Data Qualifier Flag

DOE HANFORD SITE - GROUNDWATER QUALITY DATA PLOTS


wellseries-100-199 WELL#=199-K-110A

METALS & PHYSICAL PARAMETERS

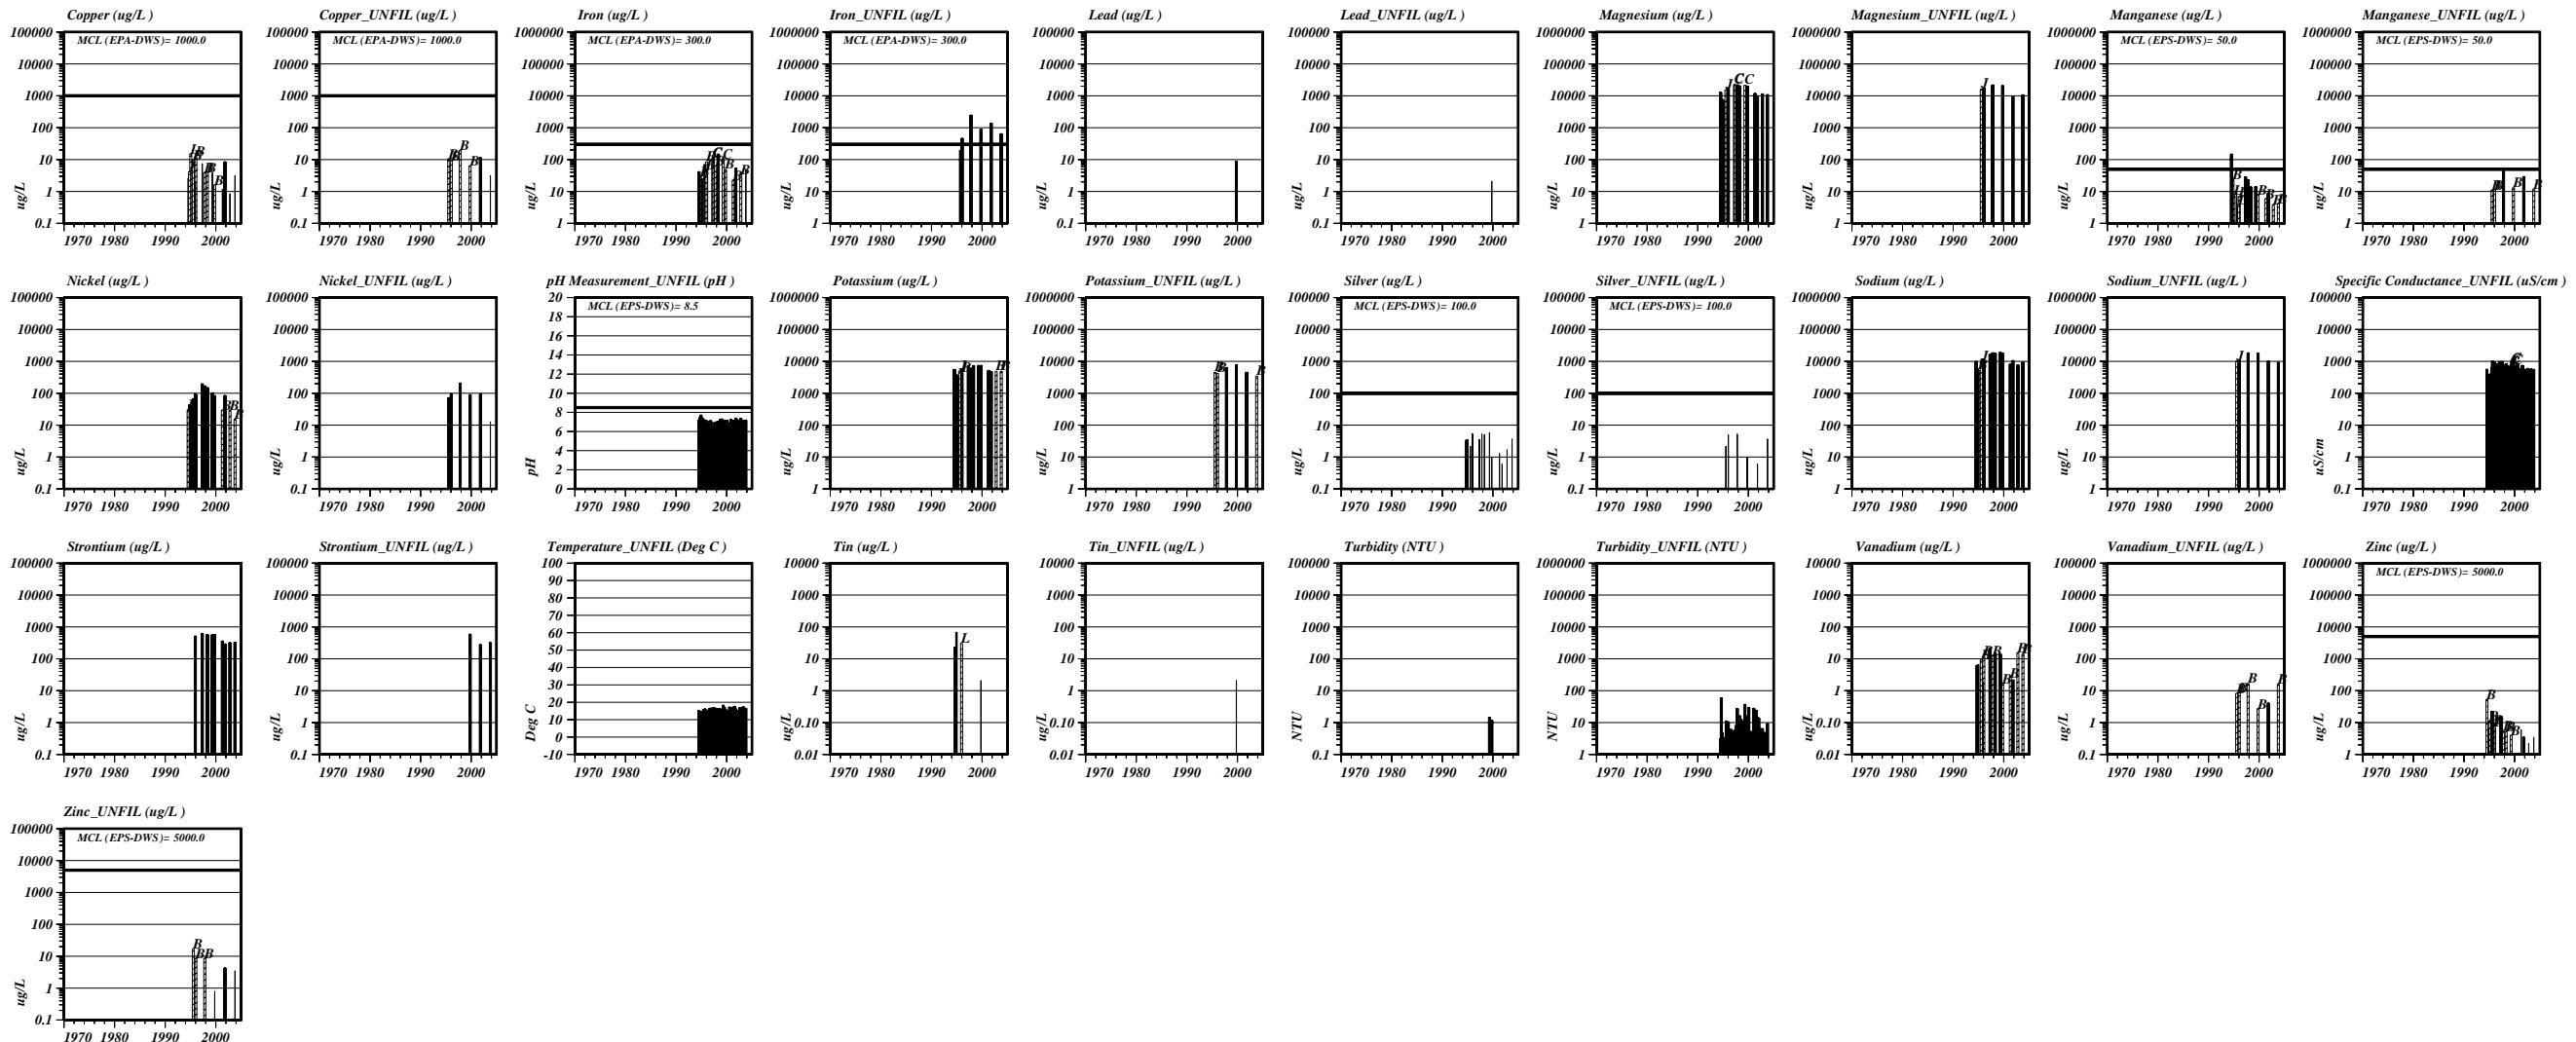

PEST/PCB, HERB, & DIOXINS NO DATA AVAILABLE

GENCHEM & ORGANICS & GENORGANICS

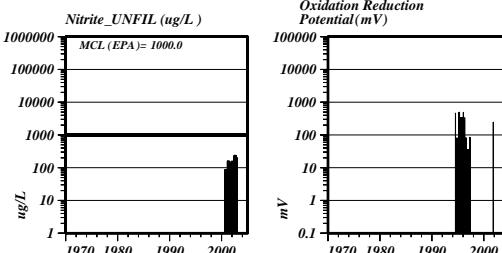

LABORATORY QUALIFIER FLAGS in HEIS are *, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value; L=Value between IDL and CRQL (estimated); T=Tentatively identified compound:
EPA-IGR=EPA-Implementation Guidance for Radionuclides: WAC=Washington Administrative Code:

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit; THIN BARS=Value Below Detection Limit; HATCHED BARS=Value With Data Qualifier Flag